

From: The Chief Electrical Inspector to Government of A.P. Mint Compound, Hyderabad - 500 063. Ph: No. 23453023.

To: M/s Narayana Hrudayalaya Mallareddy Hospital, # 1-1-216, Suraram X Roads, Jeedimetla, Ranga Reddy District.

Lr.No. CEIG-TS/HV/R.R.-359/D.No. 3337 /2010, dt. 27-06-2010.

Sir,

Sub:- The Electricity Act, 2003 and Indian Electricity Rules, 1956 - Additional M.V. Loads in the existing HV Electrical Installation of M/s Narayana Hrudayalaya Mallareddy Hospital, # 1-1-216, Suraram X Roads, Jeedimetla, Ranga Reddy District - Statutory Approval under Rule 63 (3) of Indian Electricity Rules 1956 - Accorded.

Ref:- 1) Inspection dated 29-05-2010.
2) Your letter dt. 9-6-2010.

Under Rule 63 (3) of Indian Electricity Rules, 1956, the following equipment of your HV Electrical Installation are approved for energisation.

AS PER ANNEXURE ENCLOSED

Under Rule 63 (3) of Indian Electricity Rules, 1956, any additions or alternations to your above HV Electrical Installation shall not be connected to supply until the same are approved in writing by this office.

Under Rule 30(4), 46(3) and 65 (7) of Indian Electricity Rules, 1956, you are at all times solely responsible for the maintenance of the above installation on such condition as to be free from danger.


Yours faithfully,

CHIEF ELECTRICAL INSPECTOR TO GOVERNMENT

Encls:- Details of Generator.

Copy to The Divisional Engineer/Operation/A.P.C.P.D.C.Ltd.,
Kukatpally, Ranga Reddy District for information.

Copy to Dy. Electrical Inspector/ Ranga Reddy Sub Division
Copy to the Accounts Officer/Duty Section-I,
O/o Chief Electrical Inspector to Government, Hyderabad.

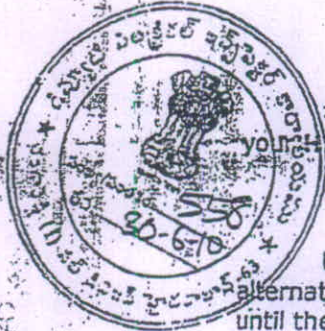


Annexure to Lr.No.CEIG/Hyd/HV/TS/R.R.-359/D.No. 3377

2010 Dt. 2-9-06-2010

M/s. NARAYANA HRUDAYALAYA MALLAREDDY HOSPITAL, # 1-1-216, SURARAM 'X' ROADS, JEEDIMETLA, RANGA REDDY DISTRICT

Details of the Equipment	Existing Load Particulars	Additional Load Particulars	Deleted Load Particulars	Total Approved Loads
TALLATION (33 KV):				
VCB	Make: Schneider Electricals. S.No.: V2Z0905036. Cap.: 1250 A, 36 KV. Qty.: 1 Set (with 3 Nos. VCB)	---	---	Make: Schneider Electricals S.No.: V2Z0905036. Cap.: 1250 A, 36 KV. Qty.: 1 Set (with 3 Nos. VCB)
Transformer	3C x 185 Sq. mm XLPE Cable - 50 Mtrs. Make: Esennar. S.No.: ET-1394. Cap.: 2000 KVA, 11KV/433V.	---	---	3C x 185 Sq. mm XLPE Cable - 50 Mtrs. Make: Esennar. S.No.: ET-1394. Cap.: 2000 KVA, 11KV/433V.
INSTALLATION:				
Motor Load.	891 KWS + 320 HP, 415 V.			891 KWS + 320 HP, 415 V.
Lighting	400 KVA, 415 V.			400 KVA, 415 V.
Other loads	900 KVAR, 415 V.			900 KVAR, 415 V.
Generator - I	Make: Leroy Somer. S.No.: 539300138. Cap.: 1010 KVA, 415 V.			Make: Leroy Somer. S.No.: 539300138. Cap.: 1010 KVA, 415 V.
Generator - II	Make: Kirloskar, S.No.: X220580-014. Cap.: 160 KVA, 415 V.			Make: Kirloskar. S.No.: X220580-014. Cap.: 160 KVA, 415 V.
Generator - III	---	Make: Leroy Somer. S.No.: C5S047A055. Cap.: 1010 KVA, 415 V.		Make: Leroy Somer. S.No.: C5S047A055. Cap.: 1010 KVA, 415 V.
INSTALLATION:				
Light Load.	180 KWS, 230 V.	---		180 KWS, 230 V.
Other loads.	250 KWS, 230 V.	---		250 KWS, 230 V.

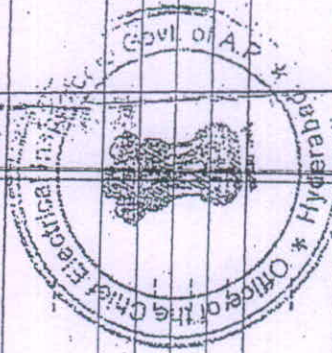

[Signature]
29/6/10
CHIEF ELECTRICAL INSPECTOR
TO GOVERNMENT

Narayana Hrudayalaya - Mallareddy Hospita,

1-1-216 Suraram 'X' Roads,

Jeedimetla - Hyderabad-500 055.

D.G. DETAILS :

ALTERNATOR MAKE	CAPACITY	ALTERNATOR SL. NO	ENGINE MAKE / SL.NO
BERROY SOMER	1010 KVA	C5S047A055	MTU /539300138

APPROVED
[Signature]
28/6/10
Chief Electrical
Inspector to Govt.

FOR LEELA ELECTRIC PROJECTS

License No: A/4868

2-1208
1011

